


APC UPS XS1500 test...


The UPS:




The Scope:

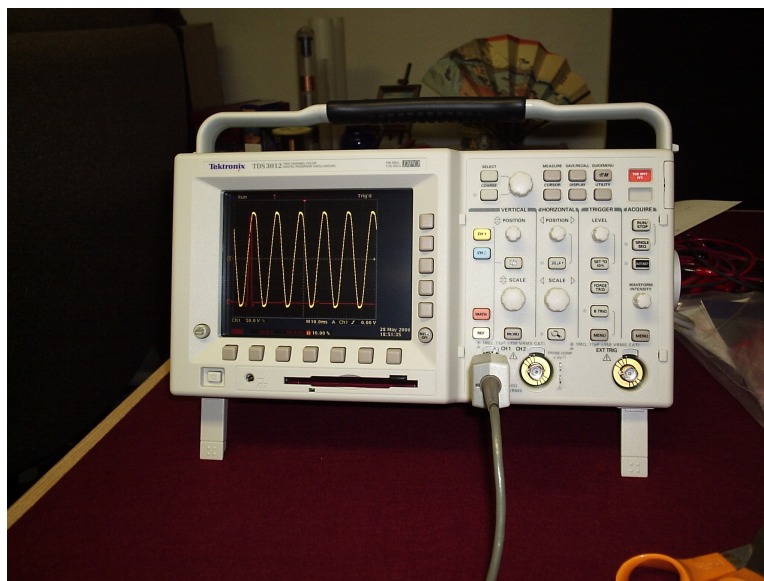


The Probe:

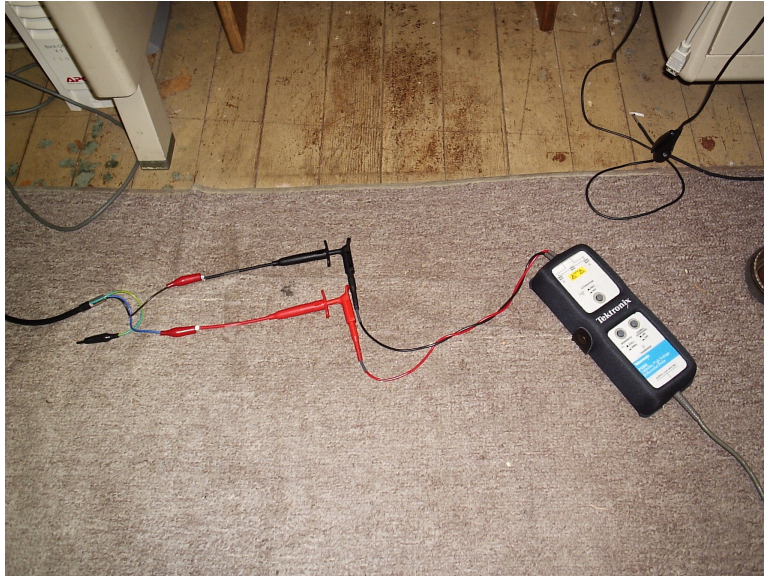

Normal AC sine wave. Note "flat topping" due to switching power supplies... FFT is in red.

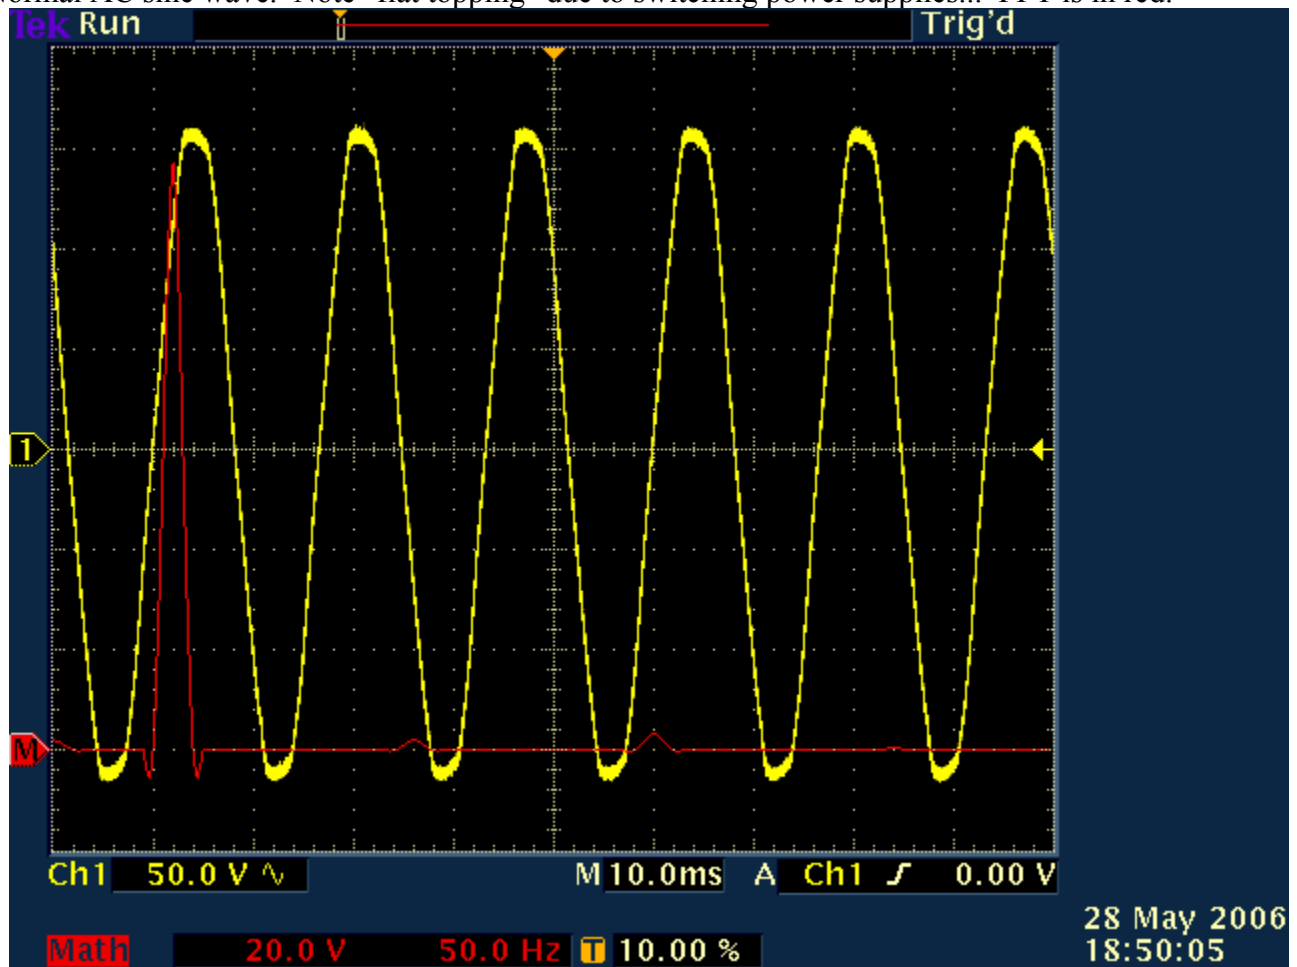

AC voltage while on UPS:

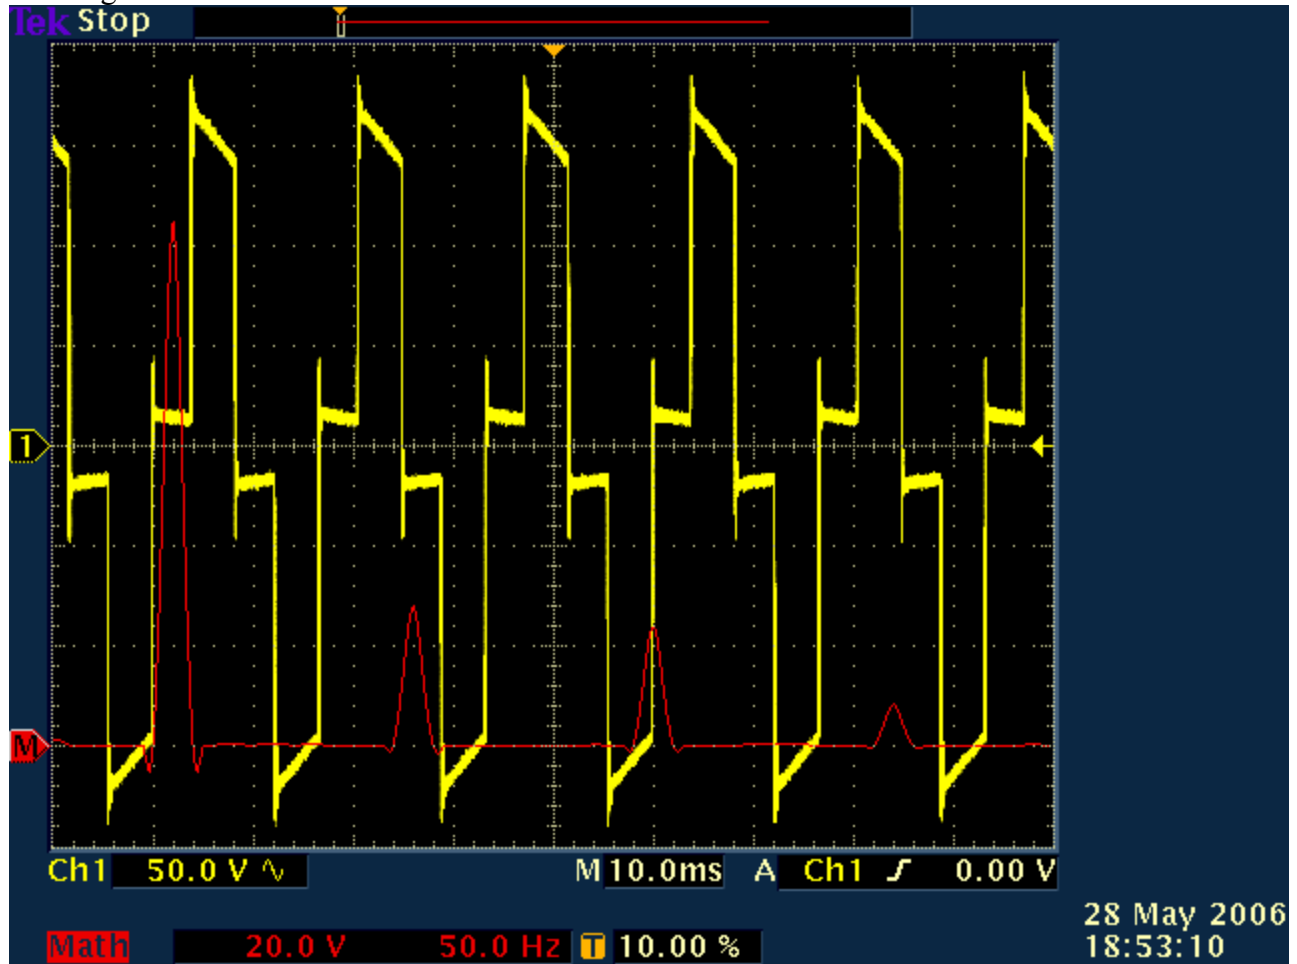

Terry Fritz May 28, 2006

Public Domain